


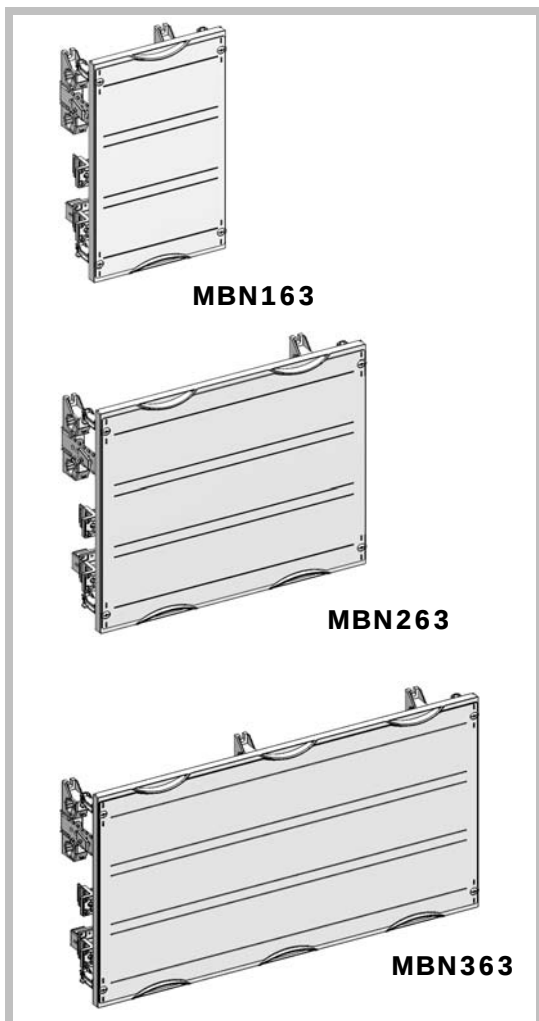

1		4 x	ED138
2		2 x	ZW59
3		2 x	ZW39
4	M5x8	4 x	ZB21
5		2 x	ED..
6		2-3 x	ZX149
7		2 x	ZW60
8	M6x20	2 x	ZX261
9	D6,2	2 x	DIN9021
10	4,8x9,5	8 x	ZB32
11		1 x	AG..

	T25	PH1 / PH2	SW5
--	------------	------------------	------------

Diagram showing the top view of a terminal block assembly. Dimension A represents the width, and dimension B represents the height. The assembly consists of three horizontal rows of terminals, each with three curved mounting points.


Diagram showing the side view of a terminal block assembly. The height is indicated as 375. The assembly consists of three vertical columns of terminals, each with three curved mounting points.

Diagram showing the WR (Wire Rack) symbol, which is a stylized 'C' shape.


Diagram showing the installation of terminal blocks into a WR (Wire Rack). The terminal blocks are shown being inserted into the rack. A warning symbol (exclamation mark inside a triangle) is present, indicating a caution or warning during installation.

	ED..	AG..	A	B
MBN163	ED51	AG13	250	450
MBN263	ED52	AG23	500	450
MBN363	ED53	AG33	750	450



1 4x

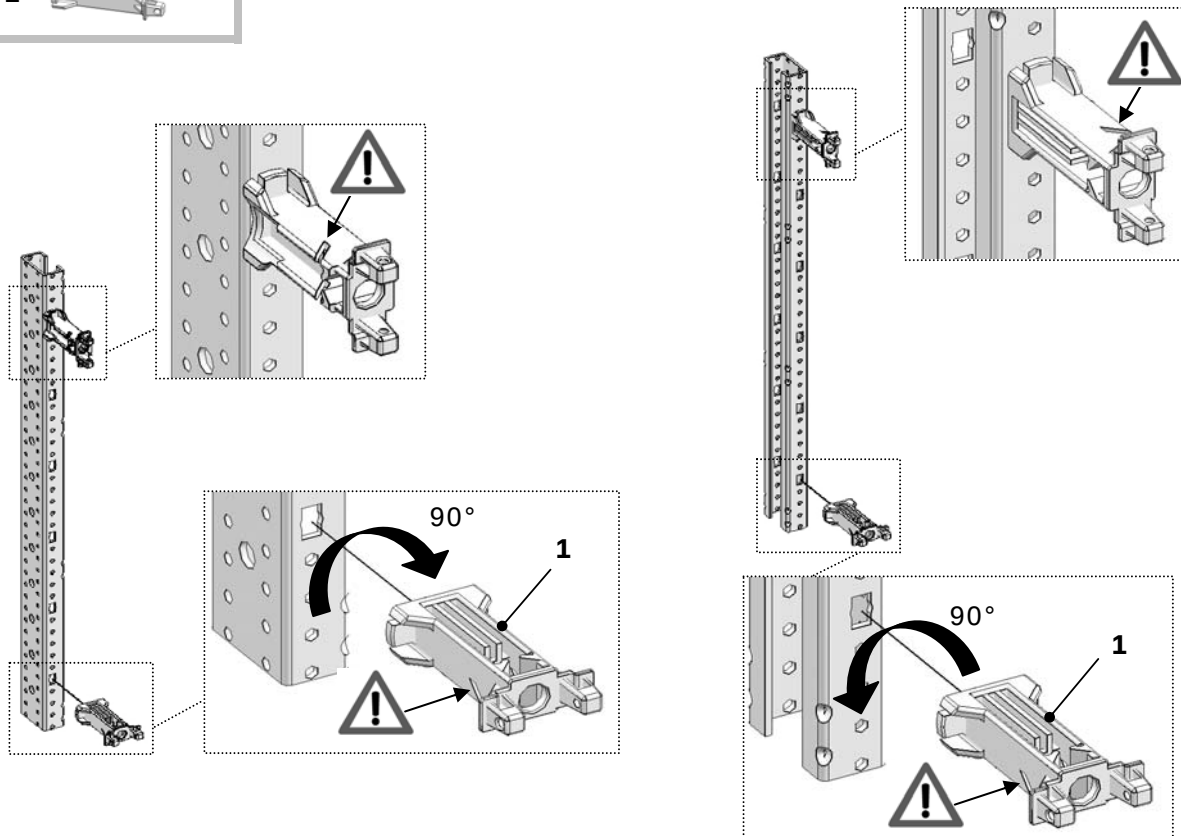


1

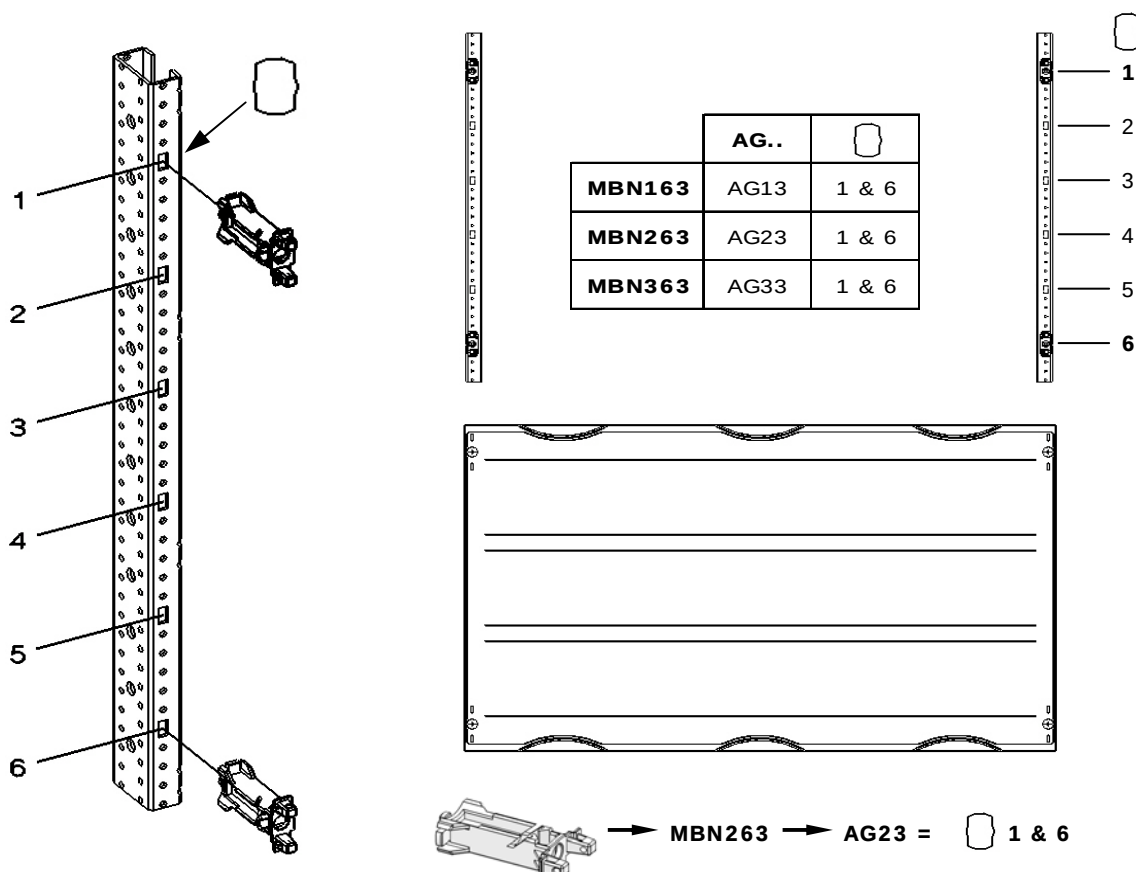

1.1

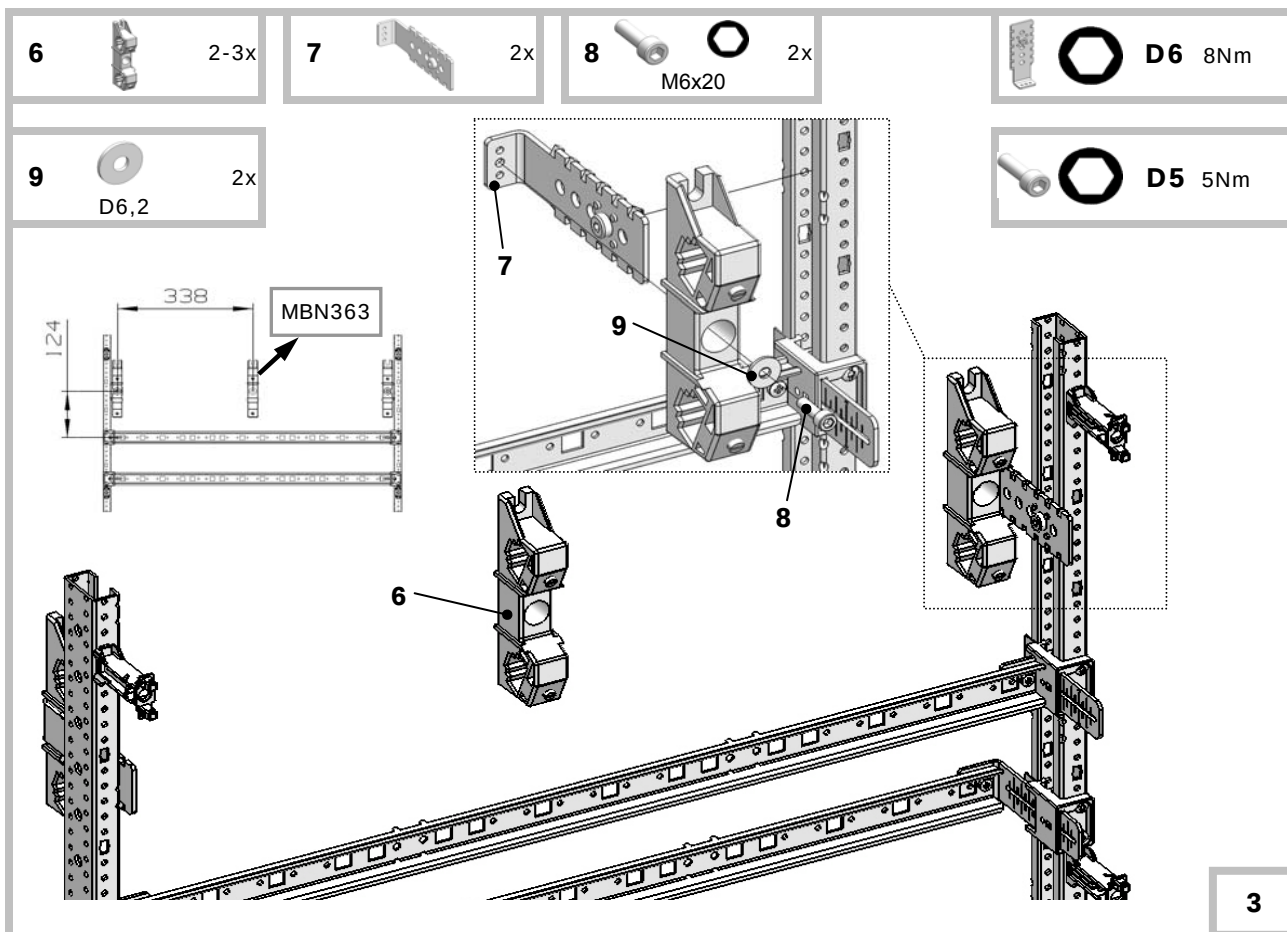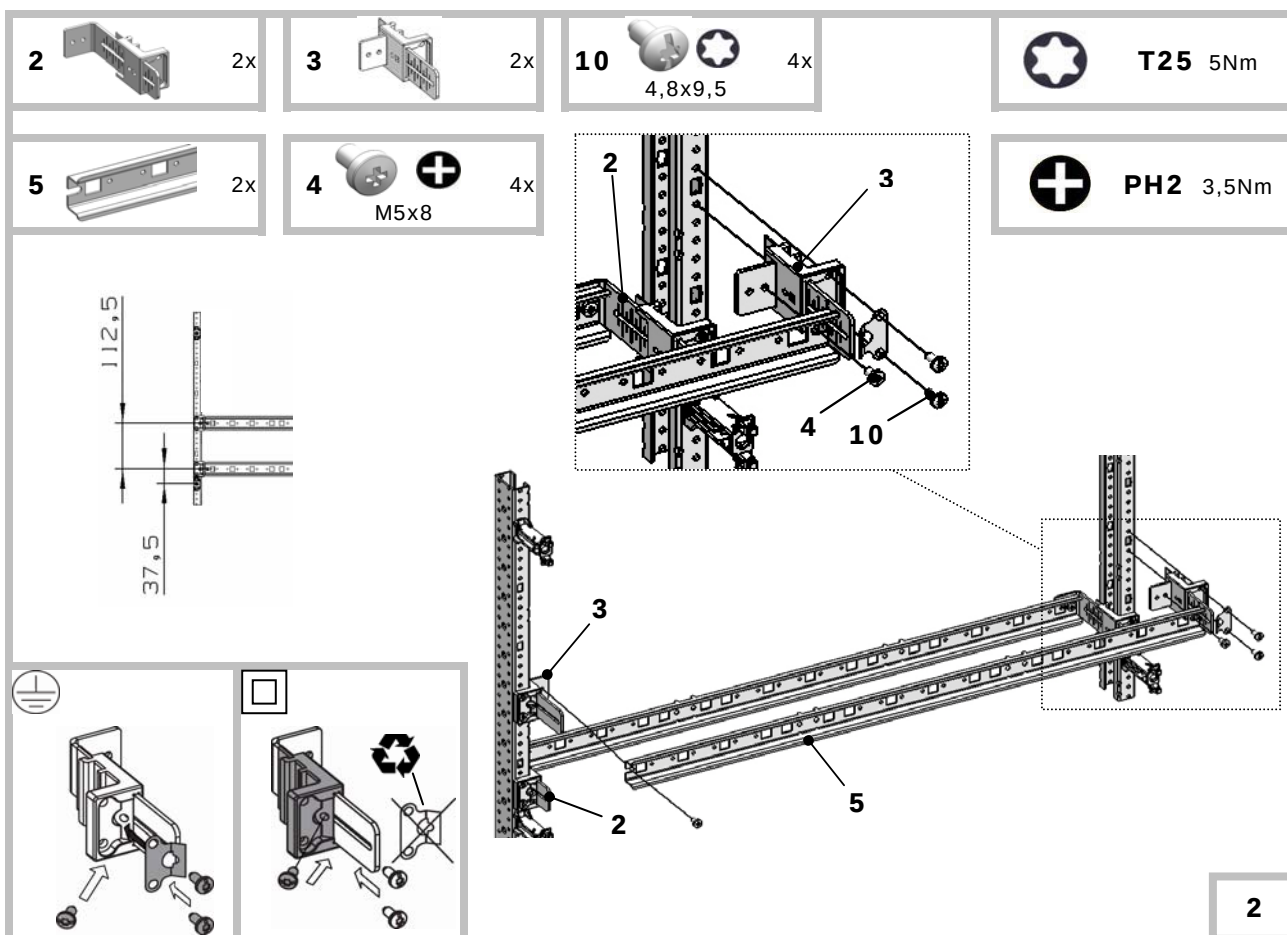


9



1x



PH2

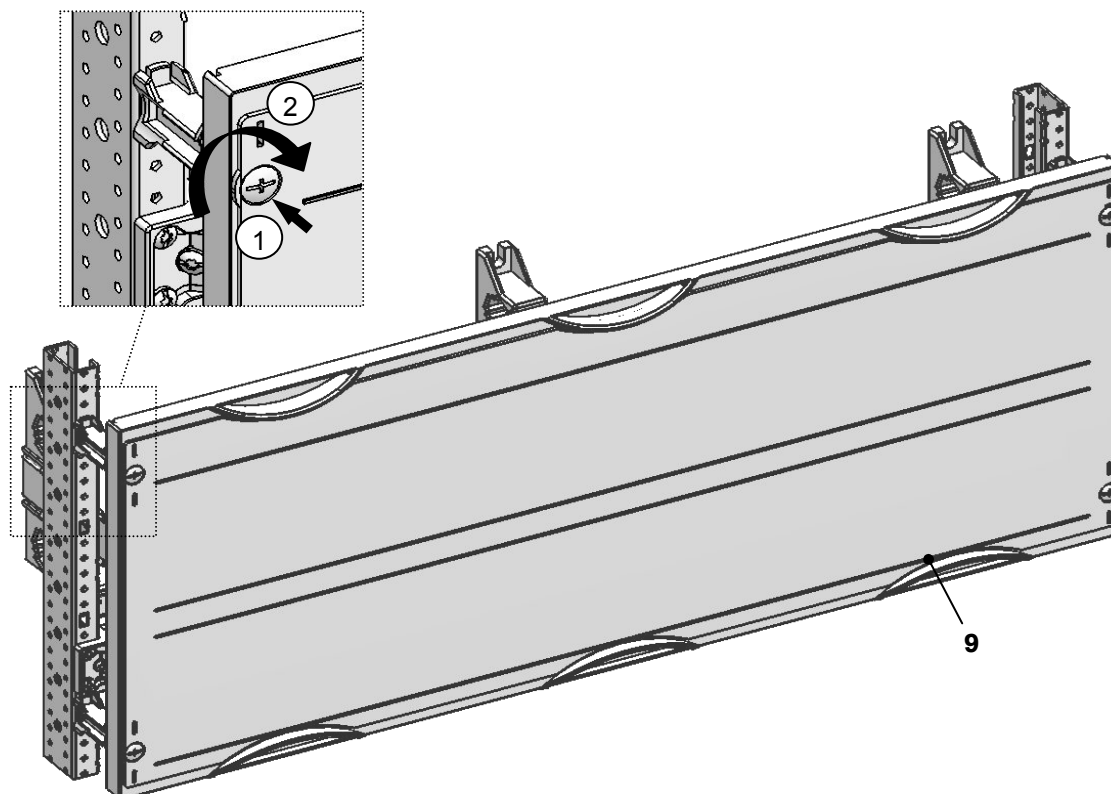

4

DE

Arbeiten an elektrischen Betriebsmitteln/Anlagen dürfen nur durch eine ausgebildete Elektrofachkraft gemäß DIN 57105 Teil 1 / VDE 0105 Teil 1 / DIN EN 50110-1 durchgeführt werden.

GB

Only qualified electrical personell according to DIN 57105 part 1 / VDE 0105 part 1 / DIN EN 50110-1 are allowed to work on electrical installations.

SE

Endast behörig personal enligt DIN 57105 part 1 / VDE 0105 part 1 / DIN EN 50110-1 är tillaten att arbeta med elektriska installationer.

IT

Solo a personale qualificato, secondo DIN 57105 part 1 / VDE 0105 part 1 / DIN EN 50110-1 è consentito di lavorare su installazioni elettriche.

FR

Seul le personnel qualifié en electricité selon DIN 57105 part 1 / VDE 0105 part 1 / DIN EN 50110-1 est autorisé à travailler sur installation électrique.

ES

Sólo electricistas cualificados según norma DIN 57105 part 1 / VDE 0105 part 1 / DIN EN 50110-1 están autorizados a trabajar en instalaciones.

RU

Согласно DIN 57105, часть 1 / VDE0105, часть 1 / DIN EN 50110-1, на электрических установках разрешается работать только квалифицированному персоналу.